

Institute of Physics

(An autonomous Research Institute of Department of Atomic Energy, Govt. of India) P:O: Sainik School, Bhubaneswar, Orissa-751005

TENDER CALL NOTICE FOR ELECTRICAL WORK

Sealed tenders in two bid system (Technical & Financial bid separately) are invited from the Electrical Contractors with valid electrical contractor license issued by Chief Electrical Inspector, Government of Orissa for the "Electrical work of proposed SUNAG laboratory". For details log on to www.iopb.res.in.

The estimated cost of the total job is Rs.8,76,550.00 only.

The sale of tender paper will be from 31st July 2009 to 20th August 2009 up to 12 noon. The tender papers will be received up to 3PM on 20th August 2009 and Technical Bid will be opened on the same day at 4.30PM.

The authority reserves the right to reject any or all tenders without assigning any reason thereof.

DIRECTOR



INSTITUTE OF PHYSICS

(AN AUTONOMOUS RESEARCH INSTITUTION OF DEPARTMENT OF ATOMIC ENERGY GOVERNMENT OF INDIA)
P.O. SAINIK SCHOOL, BHUBANESWAR-751005

TENDER DOCUMENT FOR

"Electrical work of proposed SUNAG laboratory"

TECHNICAL BID

TENDER CALL NOTICE

Sealed tenders are invited by the "Director", Institute of Physics, Bhubaneswar-751005, Orissa, comprising of technical and financial bid separately, from registered and reputed contractors, with valid Electrical License issued by Electrical Inspector of Government of Orissa for the "Electrical work of proposed SUNAG laboratory"

Name of the work	Estimated Cost	Cost of the	EMD required for	Time for
		tender paper	the work	completion
"Electrical work of proposed	Rs.8,76,550.00	Rs.200.00	Rs.22,000 (Rupees	Three Months
SUNAG laboratory"	(Rupees Eight		Twenty Two	from the date
	Lakh Seventy		Thousand only)	of issue of
	Six Thousand			work order
	Five Hundred			
	Fifty only)			

The tender documents may be purchased from the office (Accounts Section) on payment of Rs.200.00 (Rupees two hundred only) (non refundable) by cash during the office hours from 10AM to 3 PM on working days only.

Bidders may down load the Tender Documents and submit their bids as per the procedure mentioned in the tender document accompanied by a DD of Rs.200.00 (Non refundable) favoring "Institute of Physics" payable at "Bhubaneswar" towards the cost of tender paper along with the DD for EMD and other documents.

The estimated cost of the work is Rs.8,76,550.00 (Rupees eight lakh seventy six thousand five hundred fifty only).

The sale of tender paper will be from 31st July 2009 to 20th August 2009 up to 12 noon.

The tender papers will be received up to 3PM on 20th August 2009 and Technical Bid will be opened on the same day at 4.30PM (in case that day becomes a non-working day tenders (Technical Bid) shall be opened on next working day at the same time). The bidders or their authorized representative may be present at the time of opening the tender (technical bid).

The tender paper should accompany with the following documents at the time of submission:

- 1. Proof of registration with Govt. /Semi Govt. organizations like CPWD, State Electricity boards, Railways, Public sectors, DCSEM of DAE or worked for IOP etc.
- 2. Copy of PAN card, VAT clearance certificate
- 3. Copy of the Valid Electrical Contractor License.
- 4. Experience having successful completion of similar type of work during last three years.
- 5. List of similar type of works in hand/continuing.

- 6. List of equipments, accessories and infrastructure facilities possessed by the bidder.
- 7. EMD amounting to Rs.22000.00 (Rupees Twenty Two Thousand only) in shape of demand draft or bankers cheque drawn in favor of the Director, Institute of Physics, Bhubaneswar.
- 8. Any other document as mentioned in the section of special instructions to the tenderer of the tender document.
- 9. If worked for Institute of Physics copies of the work orders is to be attached.

In the absence of any of the documents listed above the tender papers will not be entertained.

Address for submission of tender: DIRECTOR, INSTITUTE OF PHYSICS, BHUBANESWAR – 751005, ORISSA.

Tenders should be submitted in sealed envelopes in two parts separately, i.e. "Technical bid" and "Price bid". Both the parts should be further sealed in an envelope super-scribing Tender no. & name of work i.e. "Electrical work of proposed SUNAG laboratory", due date for opening, bidder's name and address. The tender duly filled in & signed on each page, accepting the terms and conditions, may be sent to above mentioned address either by post or hand delivered in tender box kept in the office of the Director, It should not be handed over to any employee of the Institute. No tender shall be accepted later than the time schedule specified above. Institute will not be responsible for delay in transit if sent by post.

- Note: 1) The tenderer is requested to go through the tender documents in detail and visit the work site to make himself conversant regarding the work before filling up the tender paper.
 - 2) Director, Institute of Physics reserves the right to reject any or all tenders without assigning any reason thereof.

DIRECTOR

PART - II SPECIAL INSTRUCTIONS TO TENDERERS

PART-II: SPECIAL INSTRUCTIONS TO TENDERERS:

1. <u>Introduction:</u> Sealed tenders are invited on two part basis (i.e. 1.Technical Bid & 2. Price Bid), by the "Director, Institute of Physics, Bhubaneswar, Orissa for the work of "Electrical work of proposed SUNAG laboratory". The tender paper consists of the following: TECHNICAL BID

Part-I - Tender Notice

Part-II - Special Instructions to tenderers ANNEXURE - I, II, III, IV (For Drawings)

ANNEXURE - V (Form for the credential of the bidder)

PRICE BID - Schedule of quantities and rates

2. <u>Acceptance of Tenders:</u>

The "Director, Institute of Physics, Bhubaneswar reserves the right to reject any or all tenders without assigning any reasons therefore. The lowest or any tender will not necessarily be accepted. Any tender not supported by the information requested in tender documents or not complying the provisions in the tender is liable to be rejected.

3. Compliance with specification and tender clarifications:

Each bid shall deemed to be in full compliance with every clause of the specifications asked, unless exceptions are clearly defined and set forth in a separate sheet.

The tenderer shall note that if any clarifications regarding specifications, conditions of contract, schedule of quantities and scope of work required, he should contact Institute of Physics, Engineer-in-Charge. No claim on account of any ambiguity in any respect will be entertained after issue of work order.

4. **Sub Contractors:**

The contractor shall not sublet any/ whole part of the work without written consent of the competent authority of Institute of Physics.

5. **PRICES:**

The tenderers shall bid for the works in Indian Rupees for the Items listed in PRICE BID – Schedule of quantities and Rates.

Each tenderer shall submit unit prices and total price (as per schedule of quantities and rates)

The quantities mentioned in this schedule (Price – Bid – Schedule of quantities and Rates) shall be considered approximate only and the unit price entered in the schedule shall apply to the actual quantities measured in the completed work in accordance with the specifications. The prices quoted by the tenderer shall include the full cost of material, labour, equipment, transportation, overheads, insurance, taxes, profit and other costs associated with the completion of the work involved under the items and shall account for the full scope of the work.

Income Tax and Work Contract Tax at the prescribed rate shall be deducted at source from your bill and will be deposited with the concerned authority. Necessary TDS certificate will be issued in your favor.

The tenderer's prices shall include all insurance, taxes and duties, all traveling, transportation and accommodation costs of all his staff including supervisory personnel.

6. **Miscellaneous Works:**

In addition to the items of work specifically set out in the form of tender schedule to be performed by the contractor as per the agreement, the contractor shall at the request of Engineer,

whose decision in this regard shall be final, perform such works and supply such materials, facilities and services which are contingent to the work covered by the contract or are required for the completion of the works.

7. <u>Co-ordination of Works:</u>

The contractor shall plan his works suitably so as to avoid interference with the operations of the existing systems and the work will be carried out with minimum shut down of PDBs to be connected.

- 8 <u>Information to be included with the tender:</u> The tender shall be submitted as mentioned below:
- 8.1 **PRICE-BID:** All supporting data as required in PRICE-BID i.e. Schedule of Quantities and Rates has to be filled in the space provided in the same and to be submitted in separate sealed envelope as Price Bid. No other document is to be kept inside this envelope and the envelope is to be super scribed as "*Price Bid for the Electrical work of proposed SUNAG laboratory of IOP*".

In this bid the bidder is required to quote his rates/ prices for the works mentioned in the scope of work & technical specifications. The rates/ price should be inclusive of all material cost, labor, services, charges for the plant/ machinery/ tools & tackles required for work, freight, insurance, octroi, Govt. duties, taxes, levies up to IOP site basis. No charges towards quantity variation, escalation, site difficulties, other hidden cost even though they may not have been explicitly mentioned in the scope and schedule of works shall be payable extra or separately. It is mandatory on bidder to quote all items rate as asked for in the BOQ/ Price schedule. Failure to adhere to this condition will lead to rejection of tender. The bidders should quote unconditional rates, neatly written without any overwriting/ white fluid/ erasing and duly signed & stamped at all pages.

8.2 <u>TECHNICAL-BID</u>: In this bid, the bidder should submit his company profile, organizational setup, credentials, list of plant, machinery & tools in his possession, copies of work orders successfully executed during last three years and earnest money draft. No deviations in respect of tender conditions are acceptable. The bidder is required to attach entire tender conditions including the annexure (excluding Price Bid) & Drawings duly signed & stamped on each page as a token of acceptance to the tender conditions with this bid. This envelope is to be super scribed as "Technical Bid for the Electrical work of proposed SUNAG laboratory of IOP".

The following specific conditions/ documents are essential for pre-qualification:

The full tender document duly signed by the bidder on each page with seal has to be submitted as a token of acceptance of the terms and conditions mentioned therein.

- 8.2.3 Receipt of the cash deposit for the cost of tender paper/ DD towards the same
- 8.2.4 The tenders shall contain sufficient information to permit a detailed comparison and evaluation of the tenders.
- 8.2.5 Copies of work orders of the similar works executed earlier shall be enclosed.
- 8.2.6 Schedule of similar works executed earlier shall be submitted (Annexure-V).
- 8.2.7 Details of any deviations from the specifications.
- 8.2.8 Copy of TIN under VAT & PAN under IT act.
- 8.2.9 Copy of the Valid Electrical Contractor License.

Both the parts (Technical Bid & Price Bid) should be further sealed in an envelope superscribing Tender no. & name of work (Electrical work of proposed SUNAG laboratory), due date for opening, bidder's name and address. The tender duly filled in & signed on each page, accepting the terms and conditions may be sent to DIRECTOR, INSTITUTE OF PHYSICS, BHUBANESWAR – 751005, ORISSA, either by post or hand delivered in tender box kept in the office of the Director, It should not be handed over to any employee of the Institute. No tender shall be accepted later than the time schedule specified above. Institute will not be responsible for delay in transit if sent by post.

- 109 Terms and Payment: 90% of the total work order value will be paid after supply, installation, testing and successful commissioning of all equipments. Balance 10% will be retained as security deposit, which will be refunded after successful completion of defect liability period (Guarantee period). However contractor may raise one running bill for payment after completion of 50% of the total work, which will be released after deduction of 10% towards SD and 20% towards commissioning of the total work. This 20% will be released along with the final bill payment.
- Penalty for the delay in completion: If the contractor fails to execute and complete the work within the time specified i.e. 3 months from the date of work order or within the period of extension granted, except is so far as the delay is on the IOP account, the contractor shall accept reduction in the total amount payable to him by the IOP at the rate of 0.5% (Half percent) per week of the contract value for the actual pay occasioned and until the work shall have been completed under the contract. Subject to maximum deduction of 5% of the total value of the work.
- 11 **Proof of Ability:** The contractor shall submit the details of similar works executed by him in the form given in the Annexure-V as a proof of his ability to carry put the specified work.
- Increase or Decrease in Scope of Work: The contractor shall carry out extra work at their quoted prices in their tender document for respective items of work so long as the entire total cost of the work executed is within the limits of $\pm 25\%$ of the contract value. The quantities mentioned in schedule of quantities are indicative only and actual requirement may vary in field.
- 13 <u>Guarantee:</u> All supplied materials including hardware's and work executed by the contractor shall be guaranteed for one year from the date of commissioning.
- 14. <u>VALIDITY:</u> The tenders submitted should remain valid for acceptance for a period of 180 days from the date set for opening of the tender. The tenderer shall not be entitled during the said period of validity to revoke or cancel his tender or vary the tender given or any item thereof. In case of tenderer revoking or canceling his tender, varying any terms in regard thereof, the earnest money paid by the tenderer along with the tender shall be forfeited by the Institute of Physics.
- Security Deposit: 10% of contract value will be deducted as security deposit and will be released after one year from the date of completion of work (Defect liability period). No interest shall be paid on EMD/ Security deposit or the amount to the contractor under contract. However the amount towards security deposit can be released against submission of Bank Guarantee for the equivalent amount valid for the defect liability period by the contractor issued by a Nationalized/ Schedule Bank.
- 16 **EMD:** An earnest money of Rs.22000.00 has to be deposited along with the technical bid. The EMD shall be only in the form of Bank Draft in favor of Institute of Physics, payable at Bhubaneswar. No Cheques/ cash shall be accepted. EMD of technically disqualified bidders will be returned within 30 days from the date of evaluation of the technical bids. EMD of successful bidder will be retained by IOP during pendency of the contract & shall be adjusted towards security deposit. No interest shall be given on such EMD

- 18. **Escalation:** No escalation over and above items' rates quoted by the bidder shall be paid during the execution of contract.
- Rights reserved by IOP: Institute of Physics reserves the right to reject any or all the tenders in full or in part without assigning any reasons whatsoever, and the decision of the Institute in this regard will be binding on all the bidders. Tenders not complying any of the provisions stated in this tender document are liable to be rejected. Director, IOP reserves the right to accept or reject any tender, either in full or part, without assigning any reasons thereof and does not bind himself to accept the lowest tender.
- **20.** Entry and exit of materials from IOP campus: Materials belonging to the contractor whether consumable or non consumable should be brought inside the IOP campus with proper entry at the main gate and any material to be taken out with proper gate pass issued by the Institute.
- 21. **Termination of the contract:** The Director, IOP reserves the right to terminate the contract on account of poor workmanship, failure to mobilize site, non-compliance of set norms/ specifications for the works, delay in progress of work, violation of any contract provisions by the contractor. In such cases the contractor is liable to pay liquidated damages amounting to 10% of the total work value.
- 22. <u>Fabrication work:</u> The sample of the items like JB, switch box, DBs etc, to be used are to be got approved by EIC before execution at site. The distribution boards mentioned in work schedule/ price bid has to be fabricated in electrical panel fabrication shop approved by Institute of Physics. The DBs will be inspected by our Engineer In-charge in 3 stages and for which it has to be informed accordingly.
- 23. <u>Communication Address of Bidder:</u> Bidder should mention their detailed contact address, telephone & Fax number, E-mail address, name of authorized contact person for this tender, mobile phone number etc. in their letter head pad and same is to be attached along with the technical bid.
- 23. **Dispute:** Any dispute arising out of this contract will be subjected to jurisdiction of Bhubaneswar.
- 24. **Statutory condition:** Tender once submitted will remain with the Institute and will never be returned to the bidders. The bids will be IOP property.

Signature of the tenderer with seal

PRICE BID

SCHEDULE OF QUANTITIES FOR ELECTRICAL WORK OF PROPOSED SUNAG LABORATORY

C1	SCHEDULE OF QUANTITIES FOR ELECTRICAL W		1				
Sl.	Description	Qty.	Unit	Supply	Installation	Total unit	Amount
no	MAY DYCA CARLES S and investigation of a second in the Company					price	(in Rupees)
01	M.V. PVCA CABLES: Supply, installation testing & commissioning of 1.1KV						
	grade PVC insulated, inner sheath tapped, outer sheath PVC extruded, GI						
	strip/armored, multi stranded/ Aluminum conductor power cable as per IS 1554						
	specifications, fixed on wall/column/slab/in existing hume pipes/ trenches by						
	5mm thick GI spacer fixed/coach screws/anchor fasteners in brick/stone wall						
	/column/slab with 2mm thick GI saddle, all fixing accessories etc. complete						
	including painting of saddle /flat/angle iron etc. The space between two supports						
	shall be generally 600mm or in ground at a depth of 900mm, below ground						
	including excavation in all types of soil excluding hard rock if any cutting of existing footpath, roads etc, sand bedding, laying of baked bricks as per IS on side						
	& top, temporary reinstatement, back filling, de-watering if necessary,						
	consolidation, disposal, of excess earth with in the radius of 500mtr. Etc. all as per the instructions of engineer-in-charge.						
	The tinned copper earth wires to be laid along with the cables should be painted						
	with two coats of black bituminous compound for earth wire in ground and green						
	enamel paint for earth wire on surface & Jointing of the earth wire shall be solder						
	joints with tinned copper cable sockets & GI nuts & bolts.						
	Note: Scope includes all types of masonry work required making good to its						
	original finish of holes through wall, roads, slopes etc. after laying of the cable.						
	Make of cables: Finolex/ NICCO/ CCI/ Polycab or approved equivalent of the						
	same.						
1.1	1 no x 3 1/2 core x 50 Sqmm Al. PVCA cable and 1 no.s of 8 SWG tinned	400	Mtr				
1.1	copper earth wires. (from Main Panel to DB-1, from DB-1 to DB-2 & from	100	17161				
	30KVA UPS to DB-3)						
1.2	1 no x 3 1/2 core x 35 Sqmm Al. PVCA cable and 1 no.s of 8 SWG tinned	100	Mtr				
	copper earth wires. (From 320KVA DG panel to DB-6 excluding the existing						
	length)						
1.3	1 no x 4 core x 25 Sqmm Al. PVCA cable and 1 no.s of 8 SWG tinned copper	70	Mtr				
	earth wires. (From DB-6 to I-net room excluding the existing length)						
1.4	1 no x 3 core x 16 Sqmm Al. PVCA cable and 1 no.s of 8 SWG tinned copper	225	Mtr				
	earth wires. (From existing two 15KVA UPS to JB in main building & from						
	DB-3 to DB-5)						
1.5	1 no x 4 core x 10 Sqmm Al. PVCA cable and 1 no.s of 8 SWG tinned copper	125	Mtr				
	earth wires. (from 15KVA UPS to DB-4)						
02	Wiring in PVC Casing & Capping:						
	Supply Installation, testing & commissioning of 1100V FRLS grade PVC						
	insulated multi stranded copper conductor wires in suitable casing & capping with						
1	double interlock, meeting with IB/IS specification. Arrangements to be made for						
	holding the wires in position in trunk, on ceiling/ wall with counter sunk tinned						
1	brass wood screw fixed with nylon plug etc. complete with all accessories like						
1	right angle bend, outer inner bend, T-stopper, PVC clamps (preferable) suitable						
	pull boxes/ junction boxes of suitable size as per the site condition wherever						
	required & with necessary leads at both ends by approved copper lug, complete as						

			ı		Т	
	per the instructions of Engineer-in charge.					
	Note: 1. Connection shall be done with crimped type tinned copper lugs and					
	washers.					
	2. Casing & Capping should be white & make: Precision, Asian & circle IS 14927					
	marked or approved equivalent of the same.					
	3. All PVC insulated copper conductor FRLS grade shall be ISI marked.					
	4. Make of wires: Finolex/ L&T or approved equivalent of the same.					
2.1	3 no.s of 2.5 Sqmm & 1 no. of 1.5 Sqmm wire in PVC casing & caping.	200	Mtr	 		
2.2	2 no.s of 2.5 Sqmm & 1 no. of 1.5 Sqmm wire in PVC casing & caping.	100	Mtr	 		
2.3	2 no.s of 4 Sqmm +1 no. of 2.5 Sqmm wire in PVC casing & caping	200	Mtr	 		
03	FLEXIBLE CABLES/ WIRES:					
	Supply, installation, testing & commissioning of 1100V, FRLS grade PVC					
	insulated multi stranded copper conductor (flexible) wires/cables with ISI mark.					
	Make of the cables: Finolex or approved equivalent of same. The cables and wires					
	will be laid and fixed as per the instructions of Engineer-in-charge.					
	Note: Scope includes supply & to provide the binding tags wherever it is required					
	to bind together more than one wire/ cable being laid in the same line.					
3.1	Supply of 03 core x 2.5 Sqmm, 650/1100 FRLS grade PVC insulated multi-	400	Mtr	 		
	stranded copper conductor flexible cables					
3.2	Supply of 03 core x 4 Sqmm, 650/1100 FRLS grade PVC insulated multi-stranded	200	Mtr	 		
3.2	copper conductor flexible cables	_00	1,141			
3.3	Supply of 04 core x 6 Sqmm, 650/1100 FRLS grade PVC insulated multi-stranded	100	Mtr	 		
3.3	copper conductor flexible cables	100	17101			
3.4	Supply of 01 core x 50 Sqmm, 650/1100 FRLS grade PVC insulated multi-	10	Mtr	 		
3.4	stranded copper conductor flexible wire	10	IVIU	 		
3.5	Supply of 01 core x 25 Sqmm, 650/1100 FRLS grade PVC insulated multi-	20	Mtr	 		
3.3	stranded copper conductor flexible wire	20	IVIU	 		
3.6	Supply of 01 core x 16 Sqmm, 650/1100 FRLS grade PVC insulated multi-	100	Mtr	 		
3.0		100	IVIU	 		
2.7	stranded copper conductor flexible wire	100	Mtr			
3.7	Supply of 01 core x 04 Sqmm, 650/1100 FRLS grade PVC insulated multi-	100	Mitr	 		
4	stranded copper conductor flexible wire					
4	DISTRIBUTION BOARDS : Supply, Installation, testing & commissioning of					
	following medium voltage (415V) TP&N/SP & N distribution boards single door					
	complete with necessary SFU, MCCB, MCBs, etc. suitable for wall mounting					
	with M.S. frame work of 40x40x5mm angle mounting with M.S. enclosure					
	fabricated out of 16SWG thick M.S. CRCA sheet with concealed hinged door,					
	cam type locking arrangement etc. Suitable tinned copper bus bars have to be					
	provided for all phases, neutral and earth connections both for incoming and					
	outgoing connections. Cable end box, wire way box, including interconnections					
	with appropriate size of PVC insulated copper conductor, phase barriers, earth of					
	DB, enameled danger board, name plate, neoprene gasket for joints & door has to					
	be provided. Necessary metal treatment, two coats of red oxide paint & two coats					
	of enameled paint has to be provided. The front door (MS sheet) should have					
	necessary cutouts for knobs/ operating levers of MCB's/ MCCB/ SFU etc. Phase					
	distribution drawing etc. all as per drawings specifications etc. relevant IS &					

	· · · · · · · · · · · · · · · · · · ·		1	l .	T	,
	instruction of Engineer-in-charge (G.A. & fabrication drawing to be got approved					
	before fabrication)					
	Note: 1.MCB's shall be minimum 10KA breaking capacity					
	2. All tinned copper bus bars should be minimum of 200A rating or more than that					
	as mentioned in the drawing.					
	3. All SFU units should have to be provided with HRC fuses					
	4. Make of SFU: L & T, Siemens, or approved equivalent of the same & make of					
	MCB: Legrand/ Siemens or approved equivalent of the same.					
	5. The DBs are to be fabricated in electrical panel fabrication shop approved by					
	Institute of Physics. The DBs will be inspected by our EIC in 3 stages and for					
4.1	which it has to be informed accordingly.	0.1	G .			
4.1	DB-1(As per annexure-2)	01	Set	 		
	a) 250A TPN SFU with 250A HRC fuse for In-comer -01no.					
	b) 100A TPN SFU with HRC fuse out going – 01 no.s					
	c) 63A TPN SFU with HRC fuse out going – 02 no.s					
	d) 32A TPN SFU with HRC fuse outgoing – 03no.s					
4.2	DB-2 (As per annexure-2)	01	Set	 		
	a) 125A TPN SFU with Fuse(50KA) for In-comer - 01set					
	b) 63A TPN MCB for outgoing – 01 no.					
	c) 32A TPN MCB for outgoing – 01 no.					
	d) 40A DP MCB for outgoing – 01no.					
	e) 32A DP MCB for outgoing – 02 no.					
	f) 25A DP MCB outgoing – 04 no.					
	g) 20A DP MCB outgoing – 02 nos.					
	h) 10A DP MCB outgoing – 02 no.					
4.3	DB-3 (As per annexure-3)-Single Phase distribution.	01	Set	 		
1.5	a) 125A DP/TPN SFU with HRC fuse for incomer -01 no.	01	Bet			
	b) 40A DP MCB for outgoing – 01no					
	c) 20A DP MCB for outgoing – 04 no					
	d) 16A DP MCB for outgoing – 04 no					
	e) 10A DP MCB for outgoing – 01 nos.					
4.4	,	01	Cat			
4.4	DB-4 (As per annexure-3)	01	Set	 		
	a) 32A TPN MCB for incomer – 01 no.					
	b) 20A TPN MCB for outgoing – 02 no.					
	c) 10A TPN MCB for outgoing – 02 no	0.4	~			
4.5	DB-5 (As per annexure-4)-Single Phase distribution.	01	Set	 		
	a) 40A DP MCB for incomer -01 no.					
	b) 20A DP MCB for outgoing – 01 no					
	c) 10A DP MCB for outgoing – 05 nos					
4.6	DB-6 (As per annexure-4)	01	Set	 		
	a) 100A TPN SFU with HRC fuse for incomer– 01 no.					
	b) 63A TPN SFU with HRC fuse for outgoing – 01 no					
	c) 32A TPN MCB for outgoing – 03 no.s					
	d) 63A DP MCB for outgoing - 03 no.s					
	e) 16A DP MCB for outgoing - 01 no.s					
	f) 10A DP MCB for outgoing - 01 no.s					
L	/		ı	1	1	1


 		1		1	
MCB BOX:					
Fabrication, supply, installation, Testing and commissioning on concrete/brick					
wall/ plywood partition of local control MCB box made out of 16 SWG thick					
galvanized MS sheet with top cover also galvanized MS sheet duly fixed by SS					
screws. Necessary cut outs to be provided on the top cover for the operating lever					
of the MCB and suitable size gland holes at two ends has to be made for the MS					
conduits. MCB shall be minimum of 10 KA breaking capacity. All complete as					
per the instructions of Engineer-in-charge.					
Note: All MCB should be of Legrand or approved equivalent make.					
MCB box with DP MCB of 32A rating	01	Set	 		
(for Baking Heater)	01	Set			
MCB box with DP MCB of 25A rating	04	Set	 		
	04	Set	 		
(for AC 1 to 4)	0.4	Cart			
MCB box with DP MCB of 20A rating	04	Set	 		
(for AC 5&6, Chiller 1 &2)		_			
MCB box with DP MCB of 10A rating	02	Set	 		
(for AFM & Computer)					
OUTLET SWITCH & SOCKET BOXES:	34	Set	 		
Fabrication, supply, installation, Testing and commissioning on concrete/brick					
wall/ plywood partition of outlet switch boards made out of 16 SWG thick					
galvanized MS sheet with top cover 3mm thick Bakelite Hylam laminated sheet					
duly fixed by SS screws. The switch box will contain 4no.s of 15/5 Amp,					
250Volt, 6pin socket & 4 no.s of 15Amp switches. Necessary wiring inside the					
board has to be carried out using 2.5Sqmm copper PVC insulated single core					
flexible wire. One suitable nut and bolt has to be provided on the side wall of the					
board for earth connection. A bolted type 4 way terminal block of 50A rating is to					
be provided inside the board for looping of the connection					
Note: All switches & sockets should be of Anchor or approved equivalent.					
CONTROL SWITCH BOX:					
Fabrication, supply, installation, Testing and commissioning on concrete/brick					
wall/ plywood partition of outlet switch boards made out of 16 SWG thick					
galvanized MS sheet with top cover 3mm thick Bakelite Hylam laminated sheet					
duly fixed by SS screws. Suitable nut and bolt has to be provided on the side wall					
of the board for earth connection.					
Switch box with one number of 5A switch (Make: Anchor or approved equivalent	25	Set			
	23	Set	 		
of the same)	02	C . t			
Switch box with one number of 5A switch & one no. of Step down type,	02	Set	 		
electronics ceiling fan regulator (Anchor or approved equivalent make).					
JUNCTION BOX:					
Fabrication, supply, installation, testing and fixing on concrete/brick wall/					
plywood partition of suitable Junction box made out of 16 SWG thick galvanized					
MS sheet with top cover 3mm thick Bakelite Hylam laminated sheet duly fixed by					
SS screws. The JB will contain one 4 way bolted type terminal block. 2no.s of					
suitable size gland holes to be provided on 3 sides of JB for cable connection.					
Suitable junction box containing one bolted type terminal block of 200A rating	08	No.s	 		
and provision for connection of PVCA Al. cables as mentioned in Annexure – 1.				1	

8.2	Suitable junction box containing one bolted type terminal block of 50A rating and provision for connection of PVC casing capping wiring for lights and fans.	55	No.s	 		
09	9 <u>CONNECTION POINT BOX:</u> Fabrication, supply, installation, Testing and fixing on concrete/brick wall/ plywood partition of connection point boxes made out of 16 SWG thick galvanized MS sheet with top cover 3mm thick Bakelite Hylam laminated sheet		No.s	 		
	duly fixed by SS screws. The box is to contain One number of 5A Ceiling Rose					
	for connection of tube light fittings and fans etc. Suitable nut and bolt has to be					
	provided on the side wall of the board for earth connection.					
10	END TERMINATION OF ARMOURED CABLES:					
	End termination and connection of the following cables by crimping with supply					
	of all jointing materials like tinned copper cable sockets, cable glands, gland					
	earthing insulation tape, flux, duplicate interconnection between gland earthing					
	strip and the nearest earthing bus terminals as per the drawing, specifications,					
	Aluminum cable tag is to be provided with each end termination and all as per the					
10.1	instruction of the Engineer in charge. Make of lugs/sockets: Dowels/Jainson.	08	No.s			
10.1	3 1/2 core x 50 Sqmm Al. PVCA cable 3 1/2 core x 35 Sqmm Al. PVCA cable	03	No.s No.s	 		
10.2	4 core x 25 Sqmm Al. PVCA cable	03	No.s	 		
10.3	3 core x 16 Sqmm Al. PVCA cable	06	No.s	 		
10.4	4 core x 10 Sqmm Al. PVCA cable	02	No.s	 		
11	END TERMINATION OF FLEXIBLE CABLES/WIRES: End termination	02	110.5	 		
11	and connection (after cutting the cable from total length to the required length) of					
	the following flexible wires/cables by crimping with supply of tinned copper cable					
	sockets, insulation tapes, flux etc. as per the drawing, specification, Aluminum					
	cable tag is to be provided with each end termination and all as per the instruction					
	of Engineer in charge. Make: All cables & wires should be of Finolex or approved					
	equivalent of the same.					
11.1	2.5 Sqmm x 3core Copper conductor flexible PVC insulated cable	24	No.s	 		
11.2	4 Sqmm x 3 core copper conductor flexible PVC insulated cable	20	No.s	 		
11.3	6 Sqmm x 4core copper conductor flexible PVC insulated wire.	10	No.s	 		
11.4	50 Sqmm x 1core copper conductor flexible PVC insulated wire.	04	No.s	 		
11.5	25 Sqmm x 1core copper conductor flexible PVC insulated wire.	04	No.s	 		
11.6	16 Sqmm x 1core copper conductor flexible PVC insulated wire.	20	No.s	 		
12	EARTHING CONNECTION:					
	Supply, laying/fixing, testing & commissioning of tinned copper earth wire fixed					
	to wall side of trench/slab/column/beam/shaft with thick GI spacers and GI					
	saddles or in ground at 750mm below including excavation in ground with					
	protective baked bricks, excavation in ground refilling and back filling of trench,					
	interconnection of earth wire /strip with GI nut bolts and washers and solder					
	jointing, painting with two coats of black bituminous compound for earth					
	wire/strip in ground and green enamel paint for earth wire/strip on surface as per					
	the specifications and as per the instruction of Engineer-in-charge. Jointing of the					
12.1	earth wire shall be solder joints with tinned copper cable sockets Two numbers of 06 SWG copper wire	300	Mtr			
12.1	1 wo numbers of 00 5 w G copper wife	300	IVIU	 	1	


12.2	25 x 6 mm tinned copper strip (Scope includes supply and fixing of the suitable insulator for fixing the copper earth strip on concrete/ brick/ stone wall one at a span of 0.5 meter).	12	Mtr	 	
13	EARTH STATION: Supply, installation, testing & commissioning of tinned copper plate electrode earth station, 2.5 mtr. below ground level conforming to latest IS specifications complete with all required materials like coke/charcoal, salt, brass, nut bolts & washers, watering arrangements (GI funnel), G.I. pipe (B class), masonry chamber, heavy duty cast iron cover plates and excavation in all types of soil in ground, refilling and removal of excess earth within a radius of 500mtr etc. as per instruction of EIC drawing & specification. Note: 1. Measurement of resistance of earth station and resistance of complete scheme of earthing lay out shall be measured, recorded & got approved by EIC. 2. The copper plate should be of electrolytic grade. 3. Two nos. of 25 x 6 mm tinned copper earth flat is to be bolted to the earth plate and to be brought up to the top of pit.				
13.1	600 x 600 x 3.15 mm tinned copper plate electrode earth station	04	Set	 	
14	PVCA Cable Straight Through Jointing Kit: Supply, Installation, testing and commissioning of Straight through cable jointing kit with all accessories like, kit, compound, straight through sockets, sealing compound, tape, nuts, bolts, clamps, flux etc suitable for 3 ½ core, 35Sqmm Aluminum, PVCA cable EXHAUST FAN:	02	Set	 	
	Supply, Installation, testing & commissioning of following size of exhaust fans, single phase complete with blades, motor, scope includes supply of 3Core, copper 1.5 Sqmm, flexible chord of suitable length with 6A, 3 pin plug top, aluminum louvers, rag bolt/anchor fastener suitable MS angle iron frame made from 30x30x5 mm, 4 corners covered with 2mm thick MS sheet to form suitable circular opening with necessary fixing arrangement painting as per specification drawing & as per the instructions of EIC. Make: Crompoten Greaves or approved equivalent of the same				
15.1	300mm dia, 900rpm	10	Set	 	
16	CEILING FANS: Supply, Installation, testing & commissioning of 1200 mm sweep ceiling fans, double ball bearing, capacitor with aliminium canister complete with down rod/motor, safety chain/wire and all accessories, suitable for 230V/250V, 50Hz supply system, including continuous earthing and final connection with 1.5sq.mm multi-stranded copper conductor PVC insulated FRLS grade wires. Make: Crompton Greaves, Model: High Speed or approved equivalent of the same.	02	Set	 	
17	TUBE LIGHT FIXURES: Supply, installation, testing commissioning of tube light fixtures and fittings complete with all accessories, tube / lamp etc. on surface of slab/ beam/ false				


	ceiling by 2 numbers (minimum) of 6mm Anchor fasteners or on wall by means of 25 x 3mm GI strip bend to shape and with 2 no.s of wood screws, nylon plug etc. suitable supporting frame fixed with rag bolts grouted on the wall/ anchor fastener on the beam/ column & other fixing accessories etc., provision & connection with 1.5sq.mm multi-stranded copper conductor PVC insulated FRLS grade wires/ 2.5sq.mm copper conductor PVC insulated FRLS grade earth wire etc. with the fixture from the existing point, painting with two coats of red oxide & two coats of enameled paint, 6mm thick GI supports all as per drawing, specifications & as per the instruction of EIC. Note: 1. Sample fixture/ fitting shall be got approved from department with complete technical data. 2. All fittings should be supplied with the electronics heavy duty ballast.					
17.1	1 x 40W Fluorescent fixtures with Electronics choke/ Copper choke with starter & 2 x 36W tube/ lamp suitable for 230/ 250V, 50Hz supply system. (Make – PHILIPS, Cat no. TCS 306-236 or approved equivalent of the same)	30	Set	 		
				Tot	al	


Signature of the tenderer with seal

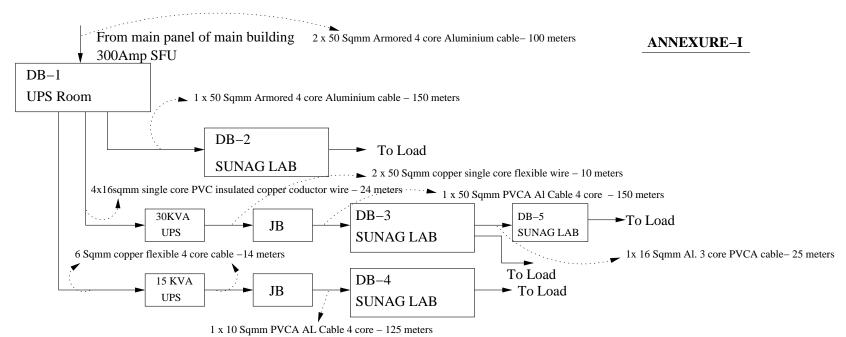



**For details of the load please refer individual DB drawings

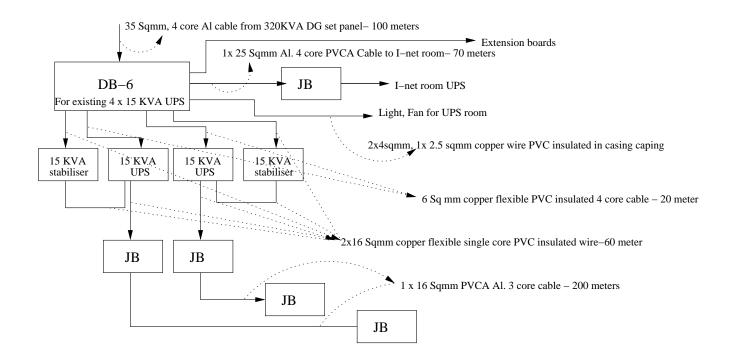

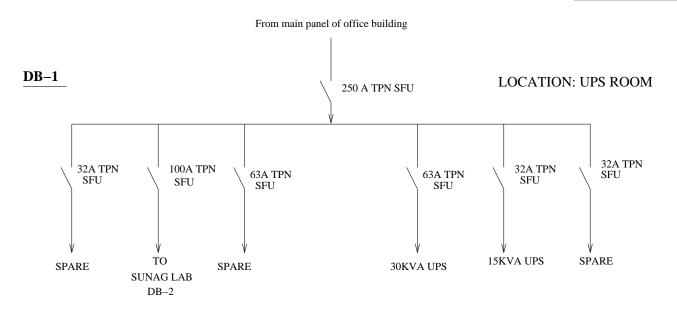

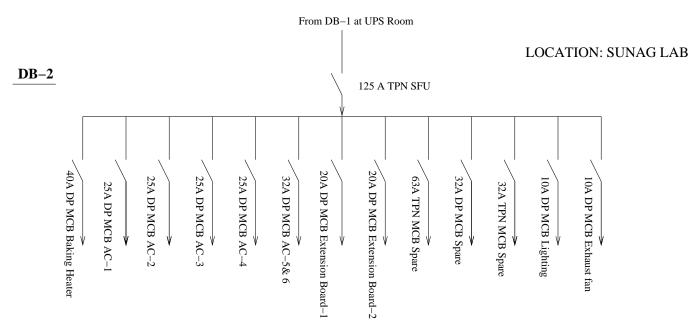

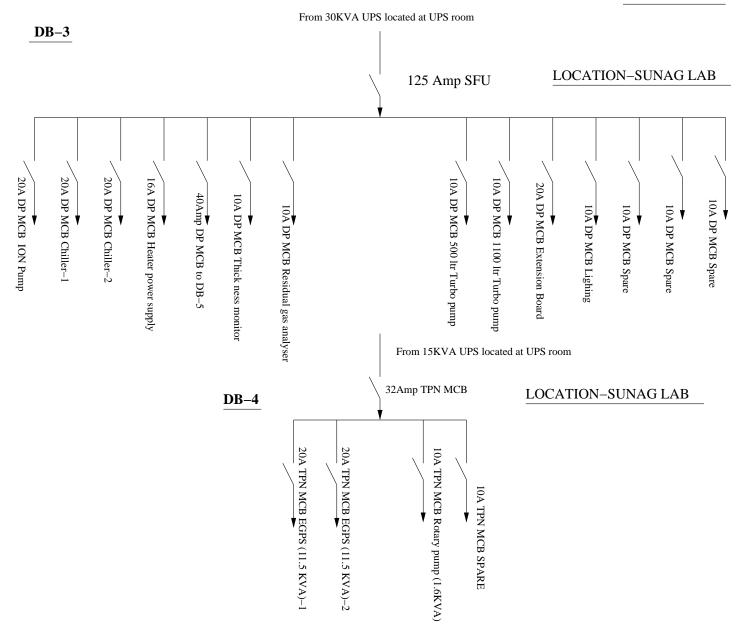

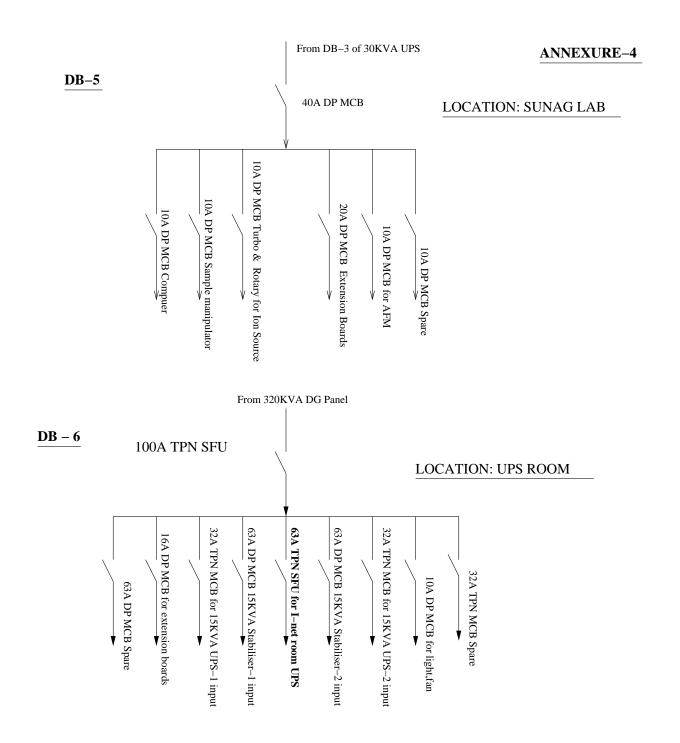

ANNEXURE-V

WORKS COMPLETED AND IN PROGRESS DURING THE LAST 3 YEARS (INCLUDING ALL WORKS AWARDED)

{ADD ADDITIONAL SHEETS, IF NECESSARY}

SI. No.	Name of Work	Date of start	Date of Co	ompletion	Reason for delay &	Tender ed	Net Amount	Name
			Stimulated Actual		compensa tion levied if any	Cost	received	Designation & Complete address of the Authority for whom the Work was done

Signature of the tenderer with seal